



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

Sr. No. **31341**

(A Government of India Enterprise)

S.No. DEL-0000431

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020

Ph : 011-26382707

Fax : 011-26382427

Email : delhinsic@nsic.co.in Website : www.nsic.co.in

## GOVERNMENT PURCHASE ENLISTMENT CERTIFICATE

Renewal Certificate (Valid From 02/03/2015 to 01/03/2017)

Ref.No NSIC/BOD/GP/DELHI/86/1291

Date: 19/06/2015

M/s. Bentex Control & Switch Gear Co.,  
B-65/3, Naraina Industrial Area, Phase-II  
New Delhi,  
DELHI- 110028

Factory Address:

1 B-65/3, Naraina Industrial Area, Phase-II  
New Delhi, DELHI -110028

Name of the Partners

- 1. Satish Chopra
- 2. Kapil Chopra

Certificate of Registration under Single Point Registration Scheme. Units registered under this scheme are considered to be at par with those registered directly with DGS & D.

Constitution of the firm- Partnership

GOVERNMENT PURCHASE REGISTRATION NO: NSIC/GP/DEL/2014/0011611

GOVERNMENT PURCHASE OLD REGISTRATION NO: NSIC/GP/RS/B-63/DELHI/1989

Monetary Limit: ₹ 935 lakhs ( ₹ Nine Hundred Thirty Five lakhs Only)

TURNOVER (Rupees in Lakhs)

Financial Year	Annual Turnover
2011-12	2295.08

2012-13	3665.76
2013-14	443.63

Monetary Limit: ₹ 935 lakhs

Your name has been registered as a SS Unit eligible for participation in the Central Government Store Purchase Programme as per the Single Point Registration Scheme for the following item(s)/Store (s)/Service(s)

Name of the Store(s)/ Service(s)	Specification(s)	Qualitative Capacity	Quantitative Capacity
As per List Attached (9 Item only)			

M/s. Bentex Control & Switch Gear Co.

  
 Authorized Signatory  
 Branch Office DELHI

Authenticity of the certificate can be checked through the web portal [www.nsicsonline.com](http://www.nsicsonline.com)

<http://www.nsic.co.in>



m/app/Administrator/RegistrationCertificatePageView.aspx?id=619/2015

CIN : U74100DL1955001002481

Conditions overleaf

Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

Bentex Control & Switchgear Co.

Authorized Signatory



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

(A Government of India Enterprise)

Sr. No. 6879  
S.No. DEL-00179

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020  
Ph : 011-26382707 Fax : 011-26382427  
Email : delhinsic@nsic.co.in Website : www.nsic.co.in

## STORE DETAILS

Renewal Certificate (Valid From 02/03/2015 to 01/03/2017)

ANNEXURE TO GOVERNMENT PURCHASES ENLISTMENT CERTIFICATE

NO. NSIC/GP/DEL/2014/0011611 D.T. 19/06/2015

ISSUED TO M/s. Bentex Control & Switch Gear Co., DELHI

B-65/3, Naraina Industrial Area, Phase-II, New Delhi, DELHI-110028

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity																		
1	ELECTRICAL ACCESORIES -Circuit Breakers for over current Protection for household and similar installations  Miniature Circuit Breakers	IS:8828:1996	A.C. AIR BREAK CIRCUIT BREAKERS, 240/415,50Hz  <table border="1"> <thead> <tr> <th>No. of pole</th> <th>Rated Short Circuit Breaking Capacity</th> <th>Rated Operational Current</th> </tr> </thead> <tbody> <tr> <td>SP B</td> <td>6000 A</td> <td>5A-40A</td> </tr> <tr> <td>SP C</td> <td>6000 A</td> <td>5A-32 A</td> </tr> <tr> <td>DP B &amp; C</td> <td>6000 A</td> <td>6A-32A</td> </tr> <tr> <td>TP B &amp; C</td> <td>6000 A</td> <td>6A-32 A</td> </tr> <tr> <td>SP, SPN, DP B&amp;C, TP, TPN</td> <td>10000 A</td> <td>1A, 1.6A, 2A, 2.5A, 3A, 4A, 5A, 6A, 8 A, 10A, 13A, 16A, 20A, 25A, 32A, 40A</td> </tr> </tbody> </table>	No. of pole	Rated Short Circuit Breaking Capacity	Rated Operational Current	SP B	6000 A	5A-40A	SP C	6000 A	5A-32 A	DP B & C	6000 A	6A-32A	TP B & C	6000 A	6A-32 A	SP, SPN, DP B&C, TP, TPN	10000 A	1A, 1.6A, 2A, 2.5A, 3A, 4A, 5A, 6A, 8 A, 10A, 13A, 16A, 20A, 25A, 32A, 40A	10,000 Nos.
No. of pole	Rated Short Circuit Breaking Capacity	Rated Operational Current																				
SP B	6000 A	5A-40A																				
SP C	6000 A	5A-32 A																				
DP B & C	6000 A	6A-32A																				
TP B & C	6000 A	6A-32 A																				
SP, SPN, DP B&C, TP, TPN	10000 A	1A, 1.6A, 2A, 2.5A, 3A, 4A, 5A, 6A, 8 A, 10A, 13A, 16A, 20A, 25A, 32A, 40A																				
2	Low Voltage switch Gear & control gear Part-4 contractors and motor Starters- Section-1 Electro Mechanical	IS:13947(Part-4/Section-1)-1993	A.C. Air Break & Oil Immersed Motor Starter  A.C. Motors Starters 3 Phase 415V, 50Hz, Rated Insulation Voltage 500V, Utilization Category AC-3, 8 Hours Continuous Duty, Degree of Protection 1P-54, Class of Insulation E, No Volt Coil Voltage 380+15% Relay Trip Class 10 Of Following Type.	1,000 Nos.																		

M/s. Bentex Control & Switch Gear Co.



Authorized Signatory

"Authenticity of the certificate can be checked through the web portal [www.nsicsonline.com](http://www.nsicsonline.com)"

<http://www.nsicsonline.com>



[om/appAdministrator/RegistrationCertificatePageView.aspx?id=6192015](http://www.nsicsonline.com/appAdministrator/RegistrationCertificatePageView.aspx?id=6192015)

Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

Bentex Control & Switchgear Co.

Authorized Signatory



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

(A Government of India Enterprise)

Sr. No. **6880**  
S.No. DEL-0000431

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020

Ph : 011-26382707

Fax : 011-26382427

Email : delhinsic@nslc.co.in

Website : www.nslc.co.in

## STORE DETAILS

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity
	Contactors and motor starters		Direct on line, Air Break, 10 HP Relay Range (10-18)A, Push Button Type, Rated Operational Current 15 A 1 e B D L  Direct on Line Oil Immersed 15 HP Relay Range (20-32) A, Push Button Type, Rated Operational Current 22 A 1 e B O I  Star Delta, Air Break, 35 HP Relay Range (42-54)A, Manually operated handle type rated operational Current 48 A 1 e S D M  Star delta, Oil Immersed 40HP Relay Range (30-42) A, Push Button Type, rated operational current 56 A, 1 e B S A  Star Delta, Oil Immersed 40HP Relay Range (30-42)A, Push Button Type Rated Operational Current 56 A, 1 e F A B with single phase Preventive Type Design  Direct On Line Oil Immersed 5 HP Relay Range (6-10)A, Push Button Type Rated Operational Current 8 A 1 e B O I  Direct On Line Oil Immersed 7.5 HP Relay Range (9-14)A, Push Button Type Rated Operational Current 12 A 1 e B O I  Direct On Line, Oil immersed 10HP Relay Range (13-21)A, Push Button Type rated Operational Current 15 A 1 e B O I  Star Delta, Oil Immersed 10HP Relay	

M/s. Bentex Control & Switch Gear Co.,



Authorized Signatory

"Authenticity of the certificate can be checked through the web portal [www.nslcspronline.com](http://www.nslcspronline.com)"

<http://www.nslcs>



[/appAdministrator/RegistrationCertificatePageView.aspx?id...](http://www.nslcs.com/appAdministrator/RegistrationCertificatePageView.aspx?id...) 6/19/2015

Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

FOR Bentex Control & Switchgear Co.

Authorized Signatory

एन एस आई सी  
**NSIC**  
 ISO 9001 : 2008

राष्ट्रीय लघु उद्योग निगम लिमिटेड  
**THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED**

(A Government of India Enterprise)

Sr. No. 6875  
 S.No. DEL-0000431

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020

Ph : 011-26382707

Fax : 011-26382427

Email : delhinsic@nslc.co.in Website : www.nsic.co.in

**STORE DETAILS**

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity
			Range(6-10)A, Push Button Type, Rated Operational Current 9 A 1 e B S A  Star Delta, Oil Immersed, 15HP Relay Range(9-14)A, Push Button Type Rated Operational Current 13 A 1 e B S A  Star Delta Oil Immersed, 20 HP Relay Range(13-21)A, Push Button Type, Rated Operational Current 18A 1 e B S A  Star Delta, Oil Immersed 25HP Relay Range(20-32)A, Push Button Type Rated Operational Current 22 A 1 e B S A  Star Delta, Oil Immersed, 30HP Relay Range (20-32)A, Push Button Type, Rated Operational Current 24A 1 e B S A  Star Delta, Oil Immrsed 35 HP Relay Range(20-32)A, Push Bulton Type, Rated Operational Current 28 A.1 e B S A	
3	A.C. Miniature Circuit-Breaker Boards For Voltage Not Exceeding 1000 Volt	As per IS:13032-1991	4 Ways To 16 Ways, 1 A to 40A	3,000 Nos. OR
4	Composite Unit of Air-Break Switches and Rewirable Type Fuses For Voltage Not Exceeding 650 Volt	As Per IS:10027:2000	TP/TPN Up to 100A	2,500 Nos. OR

M/s. Bentex Control &amp; Switch Gear Co.

"Authenticity of the certificate can be checked through the web portal [www.nsicsonline.com](http://www.nsicsonline.com)"

\* Authorised Signatory

http://www.nsicsonline.com



m/appAdministrator/RegistrationCertificatePageView.aspx?id... 6/19/2015

Bentex Control & Switchgear Co.  
 B-63-65/3, Naraina Indl. Area  
 Phase-II, New Delhi-110028

for Bentex Control & Switchgear Co.

Authorised Signatory



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

(A Government of India Enterprise)

Sr. No. **6876**  
S.No. DEL-0000491

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020  
Ph : 011-26382707 Fax : 011-26382427  
Email : delhinsic@nsic.co.in Website : www.nsic.co.in

## STORE DETAILS

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity
4	Change Over Switch	As per IS:13947 (Part-4) Section-1) 1993	TP 16A to 32A, 15, 10V to 22V, FP: 16A to 800A	2,500 Nos.
5	Change Over Switch	As per IS:13947 (Part-4) Section-1) 1993	TP 16A to 32A, FP: 16A to 800A	2,300 Nos. OR 2,000 Nos.
6	Oil Immersed Manually Operated Slipping Motor Starters (TYPE-SOSR)	As per IS:13947 (Part-4) Section-1) 1993	20 HP to 60HP, 3 Phase	500 Nos. OR
	Oil Immersed Manually Operated Floor mounting Slipping Motor Starters (TYPE-SOSR,HD)		30 HP to 350 HP, 3 Phase	100 Nos.
7	Electric Ceiling type fans and regulators.	IS:374:1979	Sweep 1200 MM, 1400 MM	5000 Nos.
8	a.c. STATIC WATT HOUR METERS, CLASS 1 AND 2	IS:13799, 1999 With Amendment No. 2 & 3	a) Single Phase, 2 wire including LCD whole current Meters: Current Ratings: 2.5 A-10A 5 A-20A 5 A-30 A 10 A-40 A 20 A-60 A 10 A-80 A Current Ratio: 2.5 A to 20 A-200% 2.5 A to 10 A-400% 5 A-600% 20 A-300%	2500 Nos.
			b) Three Phase, 4 wire including LCD whole	1500 Nos. OR



*[Signature]*  
Authorized Signatory

M/s. Bentex Control & Switch Gear Co.,

"Authenticity of the certificate can be checked through the web portal: [www.nsicsonline.com](http://www.nsicsonline.com)"

<http://www.nsic.com>

om/appAdministrator/RegistrationCertificatePageView.aspx?id... 6/19/2015



Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

Bentex Control & Switchgear Co.

Authorized Signatory



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

(A Government of India Enterprise)

Sr. No. 6877  
S.No. DEL-000039

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020

Ph : 011-26382707

Fax : 011-26382427

Email : delhinsic@nsic.co.in

Website : www.nsic.co.in

## STORE DETAILS

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity
			current Meters:- Current Ratings: 5 A – 10 A 5 A – 20 A 10 A – 20 A 10 A – 40 A 10 A – 60 A  Current Ratio: 5 A to 30 A – 200% 5 A to 10 A – 400% c) Three Phase, 4 wire including LCD C.T. operated Meters: Current Ratings: Basic current: -15 A Current Ratio: 120%	1500 Nos. OR
9.	a.c.Watt Hour Meters, Class 0.5, 1&2	IS:13010-2002 with Amendment No.1	a) Single Phase, 2 wire, whole current Meters: Basic Current: 2.5 A to 20 A Current Ratio: 2.5 A to 20 A – 200% 2.5 A to 10 A – 400% 5 A – 600% 20 A – 300% b) Three Phase, 4 wire whole current Meters: Basic Current: 5 A to 30 A Current Ratio: 5 A to 30 A – 200% 5 A to 10 A – 400% c) Three Phase, 4 wire C.T. operated Meters Current Ratings:	4000 Nos. OR 4000 Nos. OR 4000 Nos. OR

M/s. Bentex Control & Switch Gear Co.



*[Signature]*  
Authorised Signatory

"Authenticity of the certificate can be checked through the web portal [www.nsicsonline.com](http://www.nsicsonline.com)"

<http://www.nsic.com>



[/appAdministrator/RegistrationCertificatePageView.aspx?id...](http://www.nsic.com/appAdministrator/RegistrationCertificatePageView.aspx?id...) 6/19/2015

Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

Bentex Control & Switchgear Co.

Authorised Signatory



# राष्ट्रीय लघु उद्योग निगम लिमिटेड THE NATIONAL SMALL INDUSTRIES CORPORATION LIMITED

(A Government of India Enterprise)

Sr. No. 6878  
S.No. DEL-0000431

Branch Office : NTSC Complex, Okhla Industrial Estate, New Delhi-110020  
Ph : 011-26382707 Fax : 011-26382427  
Email : delhinsic@nsic.co.in Website : www.nsic.co.in

## STORE DETAILS

SNo	Store(s)/ Service(s) Name	Specification(s)	Qualitative Capacity	Quantitative Capacity
			Basic current :-/5 A Current Ratio: 120%	


Inspection agency comments / Note (Optional):



*[Signature]*  
Authorised Signatory

M/s. Bentex Control & Switch Gear Co.,

"Authenticity of the certificate can be checked through the web portal: [www.nsicsonline.com](http://www.nsicsonline.com)"

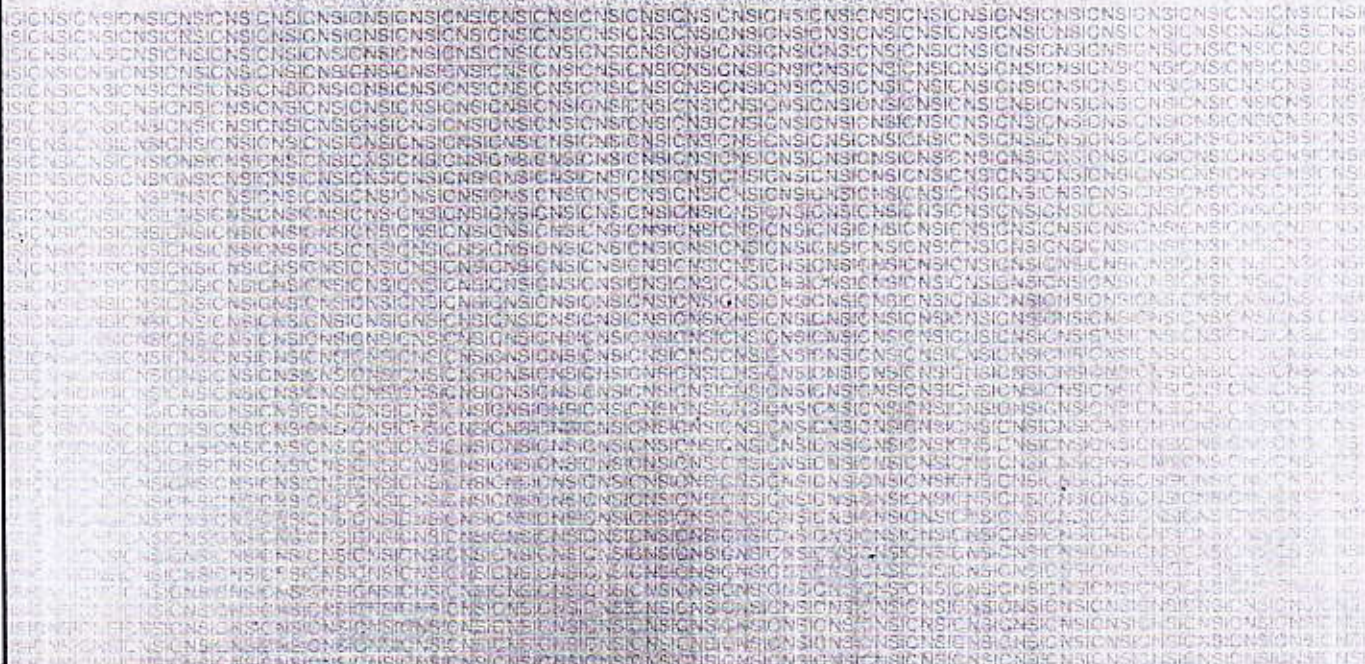

<http://www.nsicsonline.com>



[m/appAdministrator/RegistrationCertificatePageView.aspx?id...](http://www.nsicsonline.com/appAdministrator/RegistrationCertificatePageView.aspx?id...) 6/19/2015

Bentex Control & Switchgear Co.  
B-63-65/3, Naraina Indl. Area  
Phase-II, New Delhi-110028

Bentex Control & Switchgear Co.

Authorised Signatory